





## Spicket River Urban Waters – Water Quality Data May 2013


May 21, 2013					
Parameter					
Site	Temperature (°C)	Dissolved Oxygen (mg/L)	Conductivity (µS/cm)	pH	Total Dissolved Solids (g/L)
Manchester Street Park	18.51	6.98	505	7.25	0.328
Central Catholic	18.57	8.39	446	7.37	0.331
Hayden-Schofield Park	18.54	7.85	447	7.40	0.331
Nina Scarito Park	18.41	7.76	446	7.45	0.332
Misserville Park	18.35	7.95	458	7.39	0.341
Ferrous Site	18.04	8.72	219	7.47	0.164

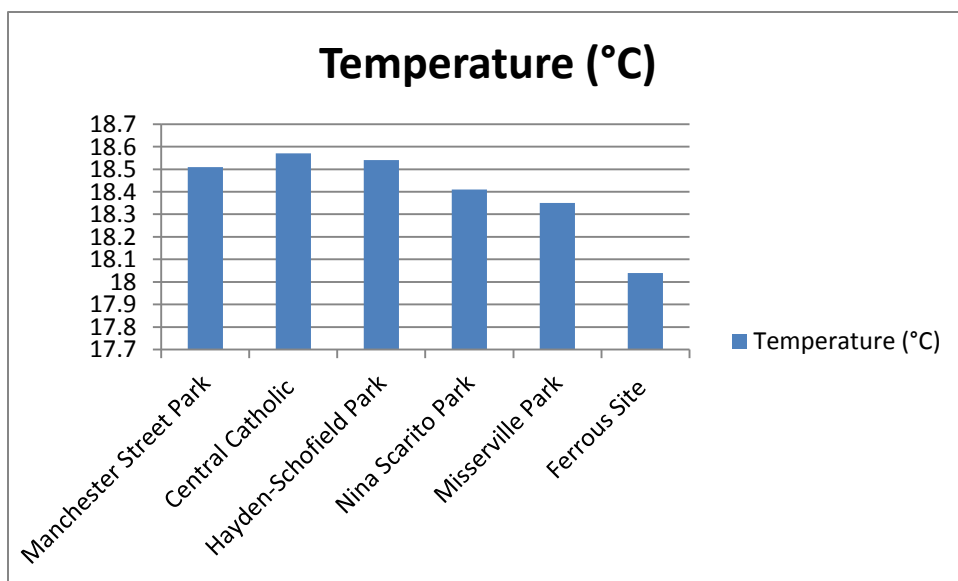


### Dissolved Oxygen (mg/L)

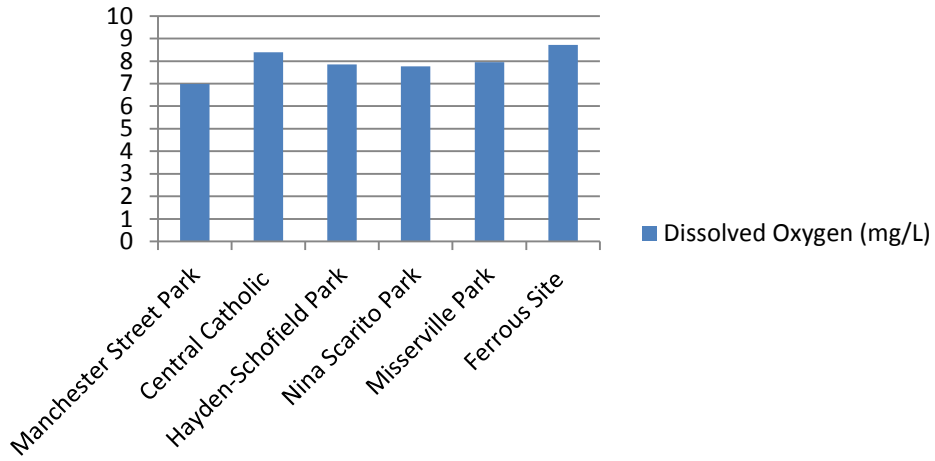


### Conductivity ( $\mu\text{S}/\text{cm}$ )

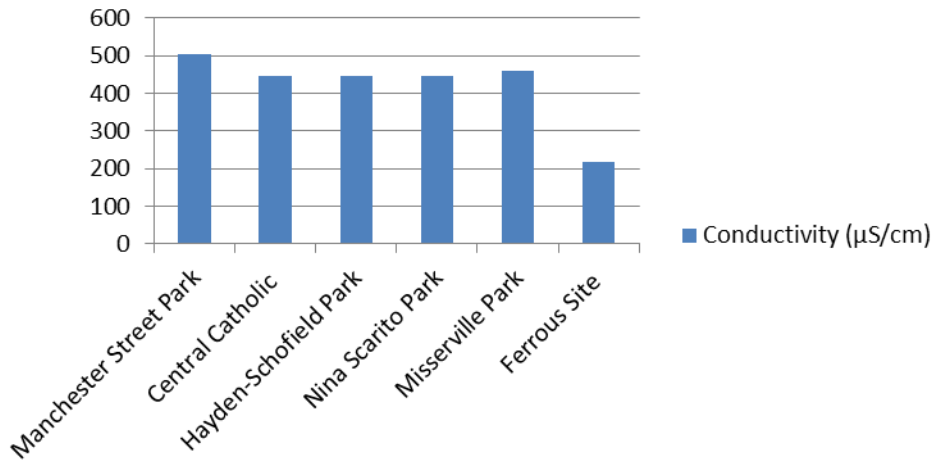




### pH

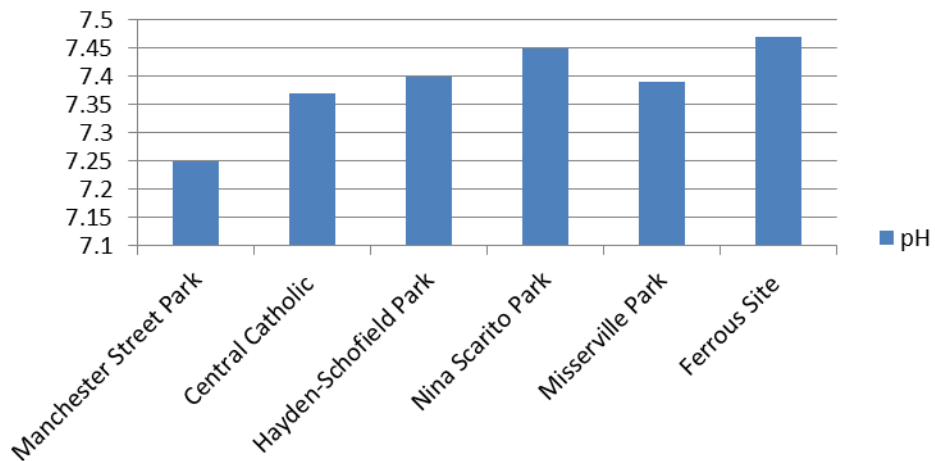

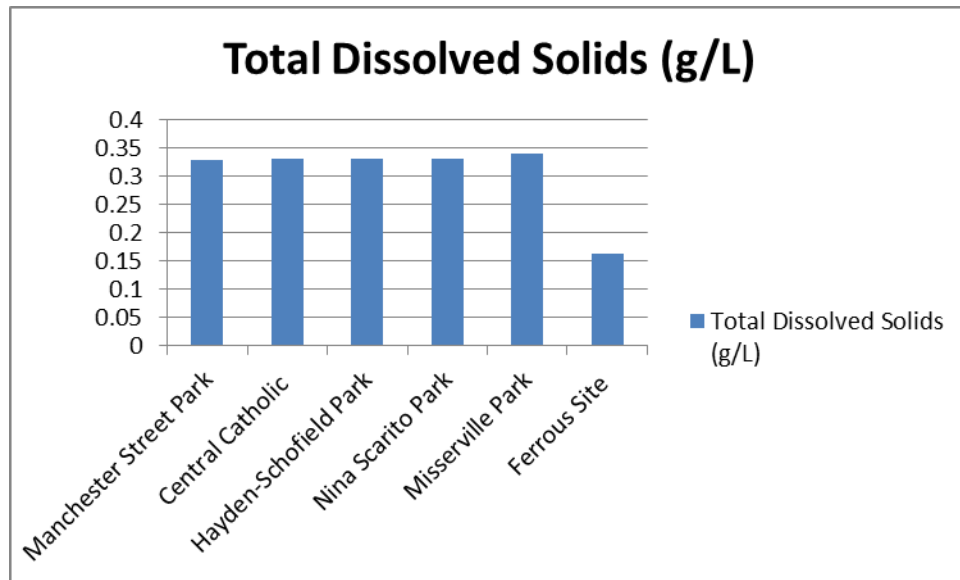

## Nutrient (Nitrates, Total Phosphorus, and Orthophosphates) & Turbidity Data

May 21, 2013				
Parameter				
Site	Nitrates (NO <sub>3</sub> )	Total Phosphorus	Orthophosphates	Turbidity
<b>Manchester Street Park</b>	0.27	0.04	0.03	2.65
<b>Central Catholic</b>	0.26	0.04	0.03	2.91
<b>Hayden-Schofield Park</b>	0.23	0.03	0.02	2.29
<b>Nina Scarito Park</b>	0.36	0.12	0.02	1.94
<b>Misserville Park</b>	0.3	0.04	0.03	1.67
<b>Ferrous Site</b>	0.52	0.05	0.04	3.46

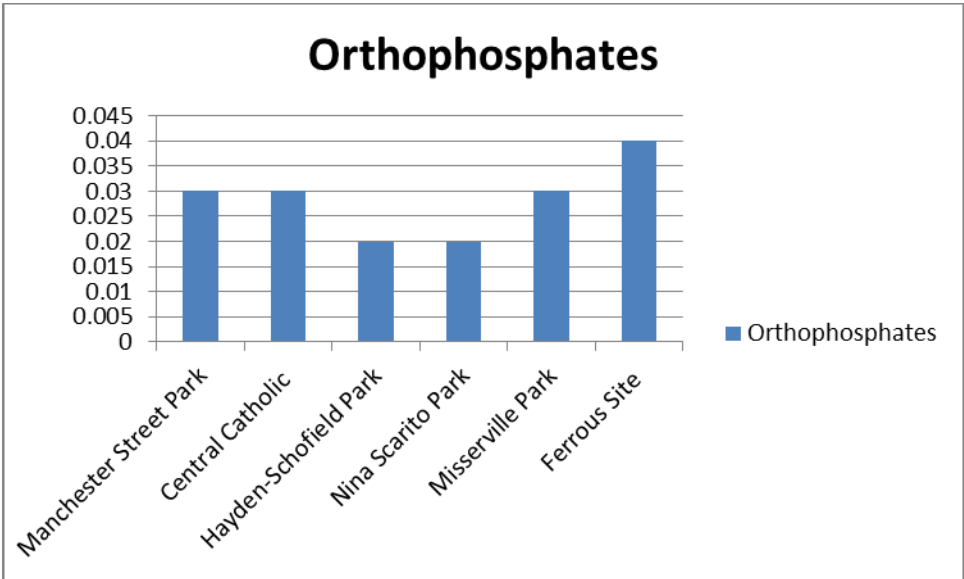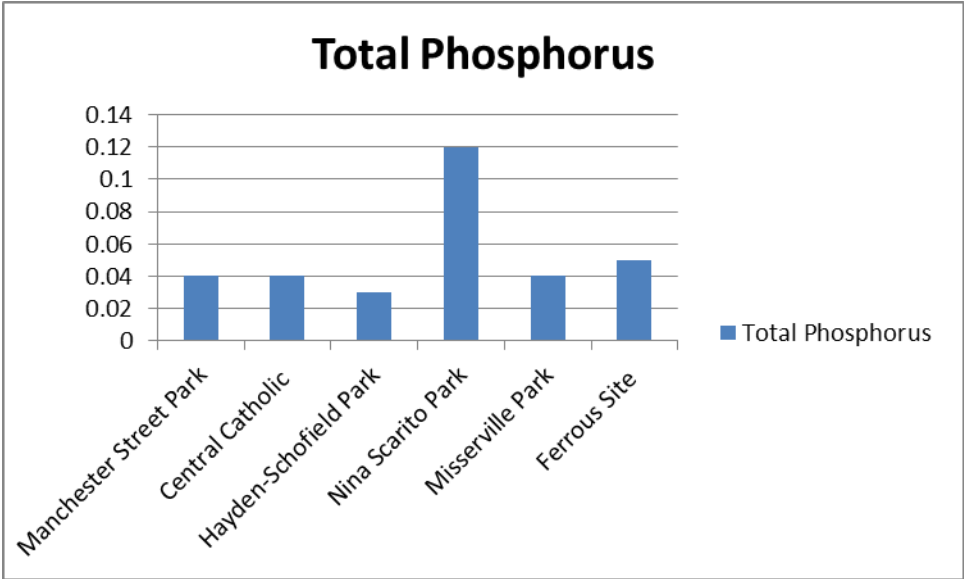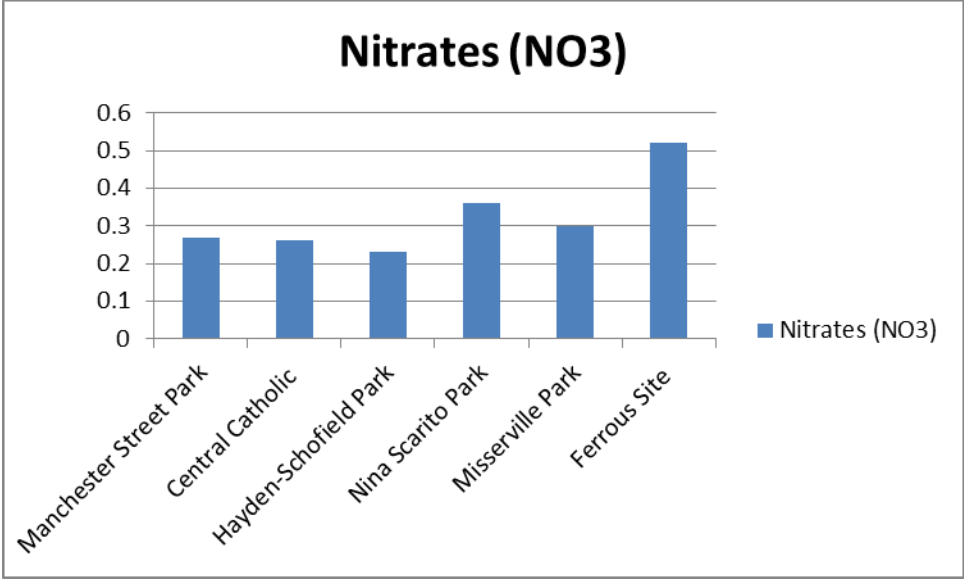

# Turbidity

