





## Spicket River Urban Waters – Water Quality Data June 2013


June 18, 2013					
Parameter					
Site	Temperature (°C)	Dissolved Oxygen (mg/L)	Conductivity (µS/cm)	pH	Total Dissolved Solids (g/L)
Manchester Street Park	18.79	8.21	0.274	7.40	0.178
Central Catholic	19.02	8.79	0.270	7.11	0.176
Hayden-Schofield Park	19.02	8.54	0.270	7.15	0.176
Nina Scarito Park	19.01	8.45	0.270	7.10	0.176
Misserville Park	18.99	8.39	0.273	7.17	0.178
Ferrous Site	19.19	8.41	0.226	7.27	0.147
<b>DUPLICATE: Ferrous Site</b>	19.04	8.66	0.201	7.15	0.129

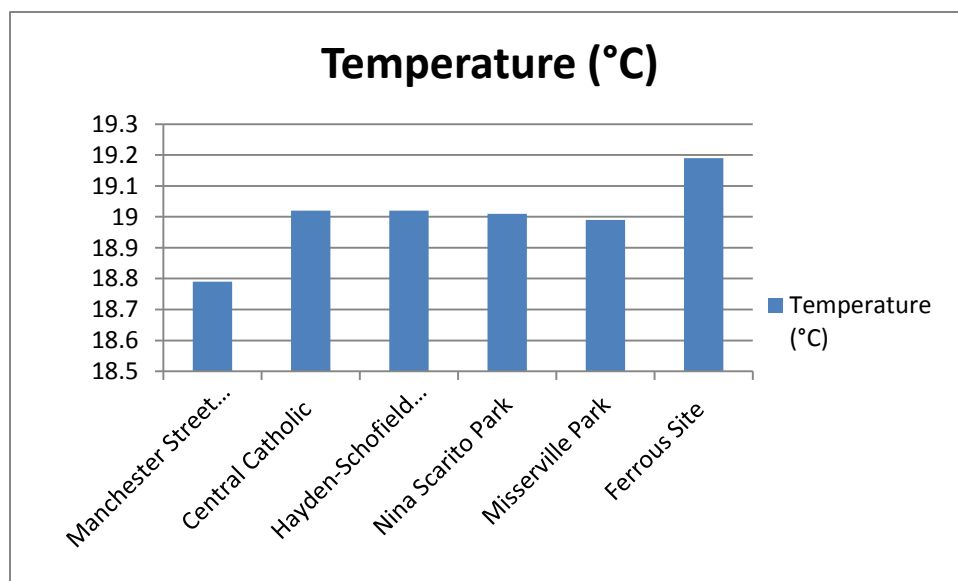


## Dissolved Oxygen (mg/L)

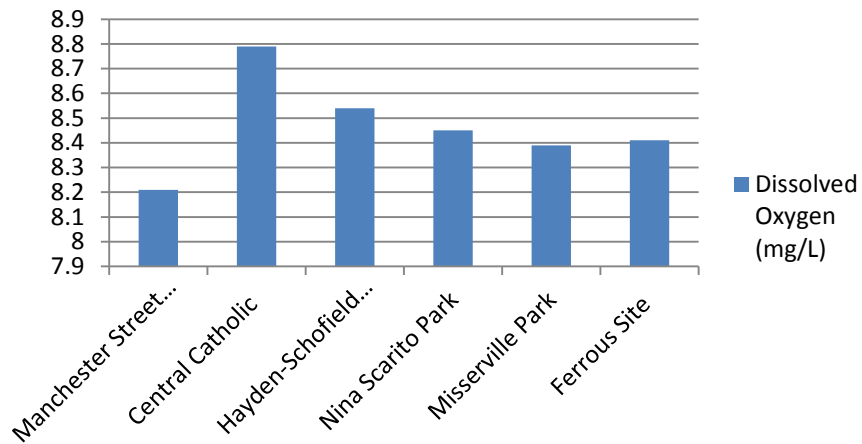


## Conductivity ( $\mu\text{S}/\text{cm}$ )

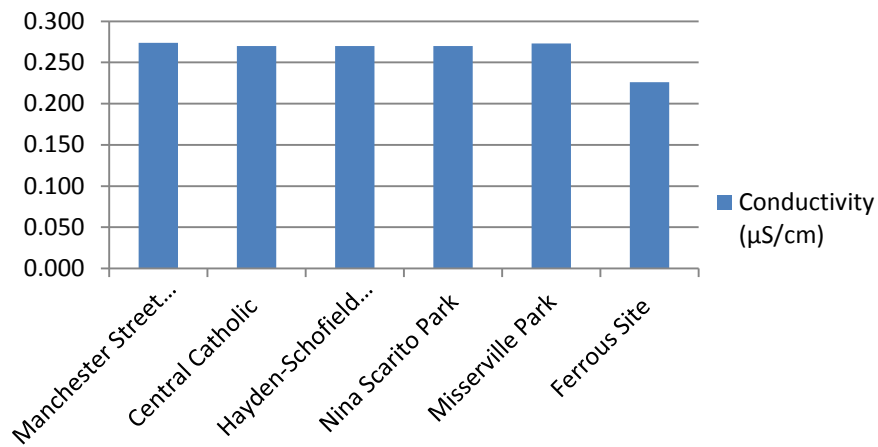

## pH

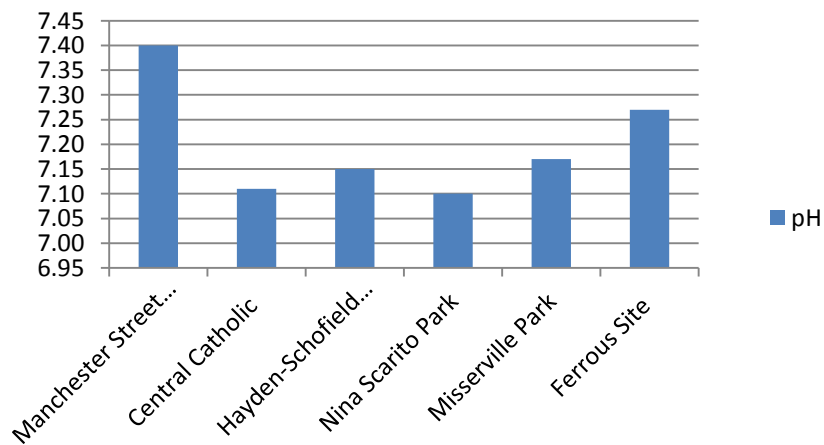


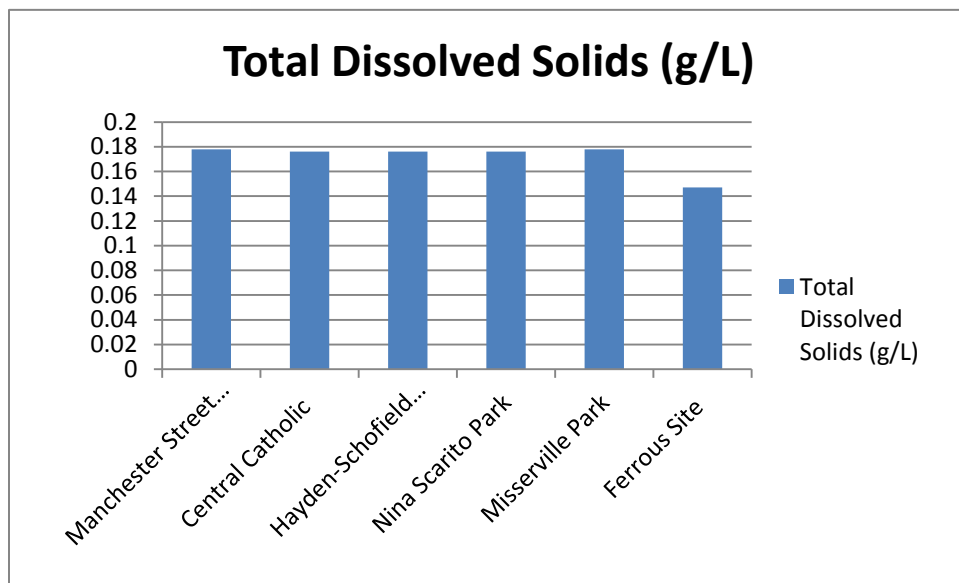


## Nutrient (Nitrates, Total Phosphorus, and Orthophosphates) & Turbidity Data

June 18, 2013				
Parameter				
Site	Nitrates (NO <sub>3</sub> )	Total Phosphorus	Orthophosphates	Turbidity
<b>Manchester Street Park</b>	0.14	0.09	x	3.24
<b>Central Catholic</b>	0.12	0.09	0.07	2.93
<b>Hayden-Schofield Park</b>	0.18	0.08	0.09	3.08
<b>Nina Scarito Park</b>	0.15	0.08	0.09	2.86
<b>Misserville Park</b>	0.13	0.08	0.09	3.59
<b>Ferrous Site</b>	0.14	0.02	x	3.22

### Nitrates (NO3)

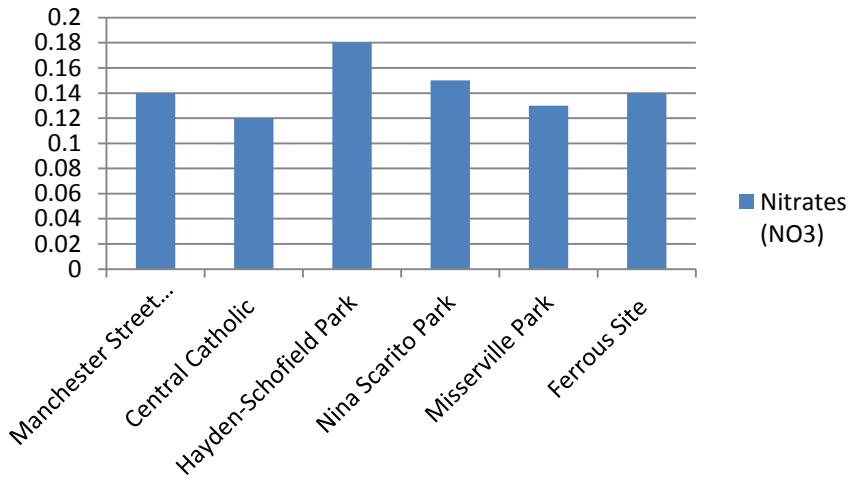

### Total Phosphorus

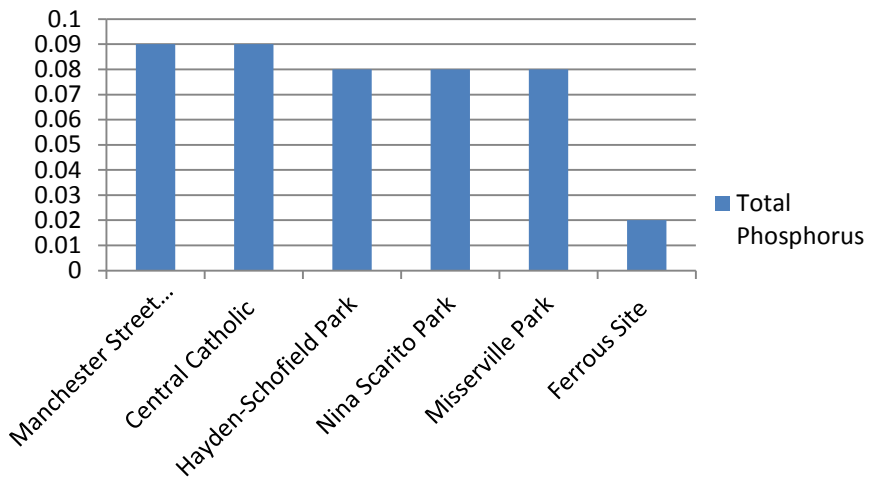

### Orthophosphates

