





## October, 2013

Site	Parameters				
	Temperature (C)	Dissolved Oxygen (mg/L)	Conductivity ( $\mu\text{S/cm}$ )	pH	Total Dissolved Solids (G/L)
Manchester Street Park	13.5	6.76	329	7.4	2.58
Central Catholic	13.79	9.44	344	7.53	0.27
Hayden-Schofield Park	13.9	8.72	345	7.60	0.272
Nina Scarito Park	15.78	6.3	939	7.57	0.772
Misserville Park	14.16	9.79	366	7.8	0.29
Ferrous Site	15.29	9.96	198	7.93	0.162
Duplicate					


## Nutrient (Nitrates, Total Phosphorus, and Orthophosphates) & Turbidity Data

Site	Parameters				
	Nitrates	Total Phosphorus	Orthophosphates	Turbidity (NTU)	E. Coli (CFU)
Manchester Street Park	0.11	0	0	3.27	31.1
Central Catholic		0	0	2.19	124.3
Hayden-Schofield Park		0	0	1.69	77.6
Nina Scarito Park	1.22	0.05	0	1.59	1011.2
Misserville Park	0.36	0	0	1.56	228.2
Ferrous Site	0.84	0	0	1.26	158.5
Duplicate					159.4

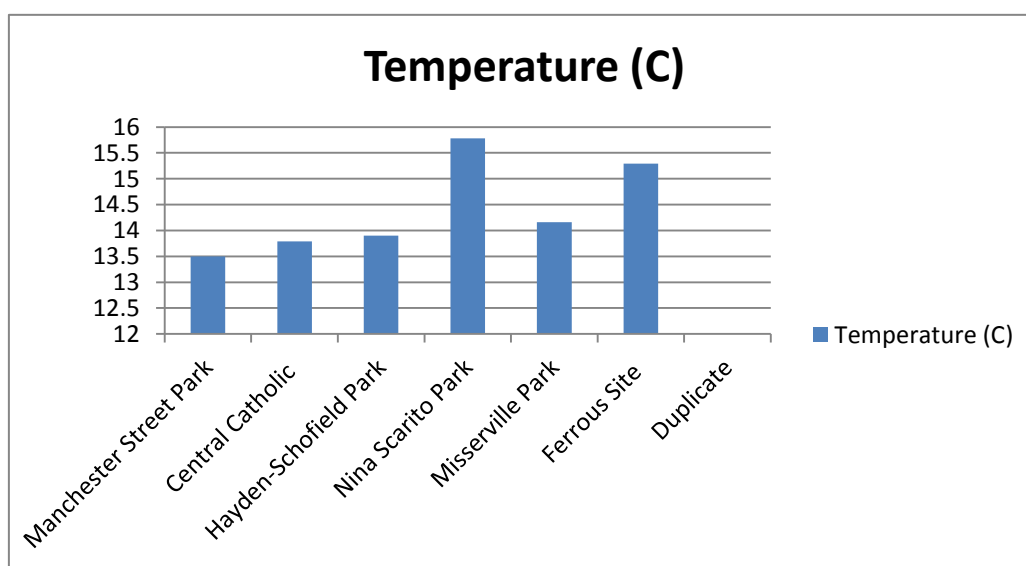


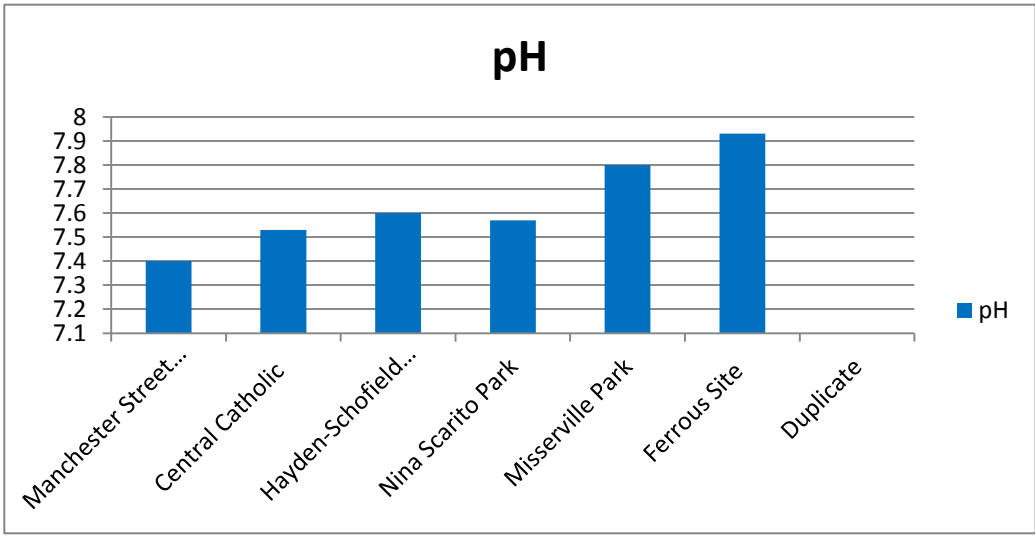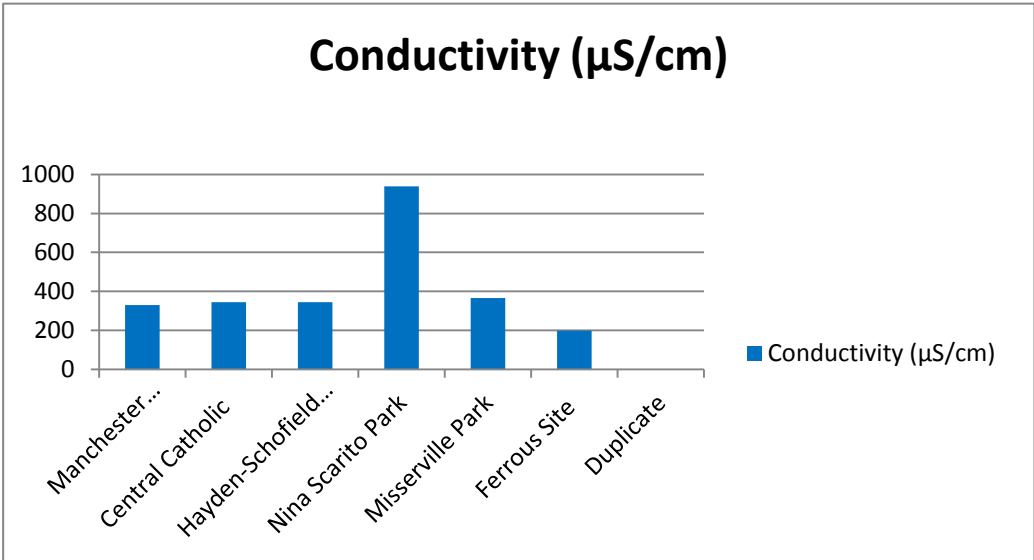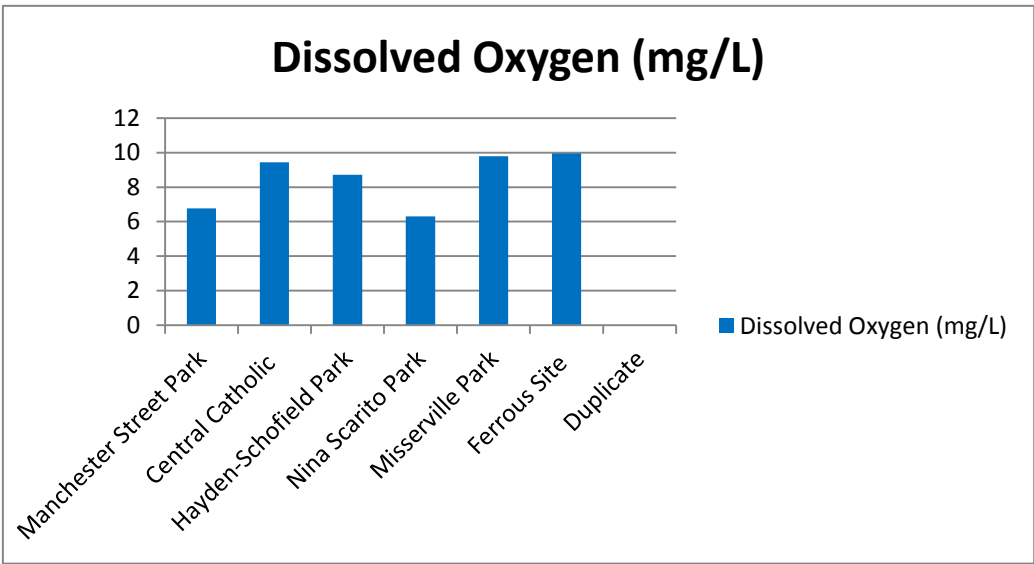

### Total Dissolved Solids (G/L)

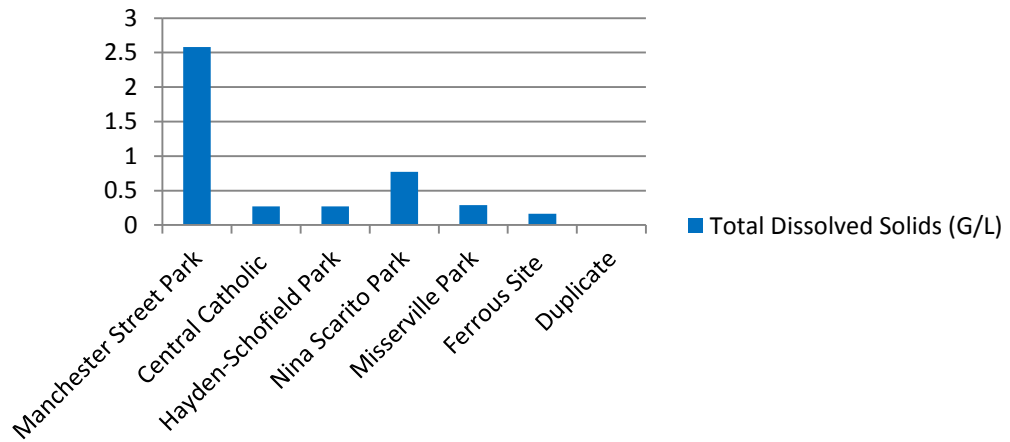

### Nitrates

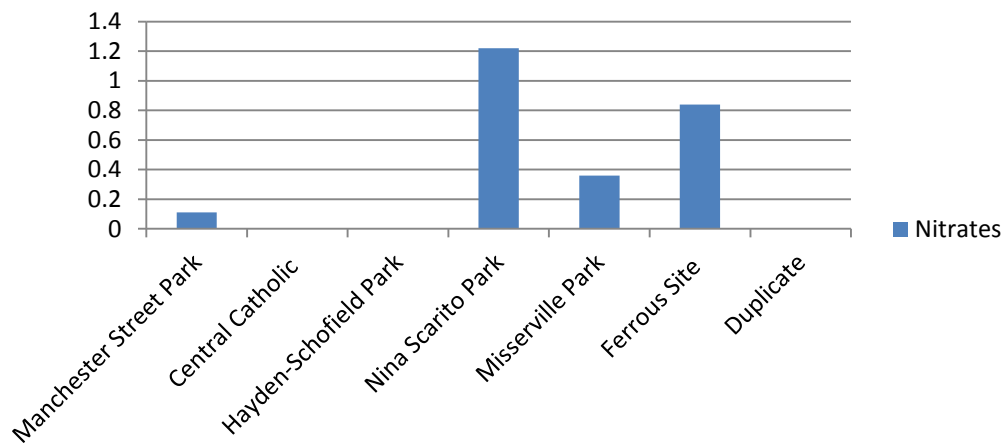

### Total Phosphorus

