





Spicket River Urban Waters – Water Quality Data April 2013


April 23, 2013				
Parameter				
Site	Temperature (°C)	Dissolved Oxygen (mg/L)	Conductivity (µS/cm)	pH
Manchester Street Park	10.78	9.57	435	8.06
Central Catholic	10.67	10.91	418	7.77
Hayden-Schofield Park	11.16	10.25	415	7.70
Nina Scarito Park	11.30	9.89	411	7.68
Misserville Park	10.83	9.97	426	7.55
Ferrous Site	10.40	10.43	342	7.54

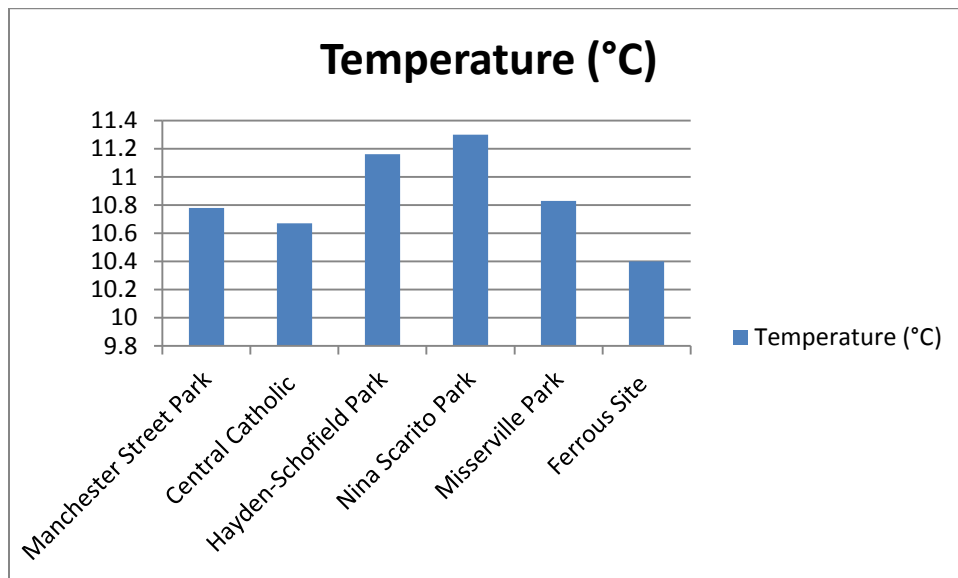

Dissolved Oxygen (mg/L)

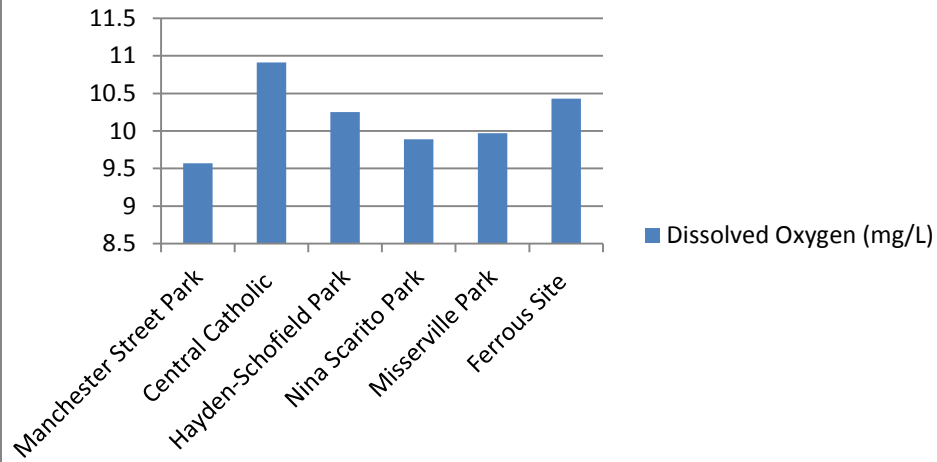

Conductivity ($\mu\text{S}/\text{cm}$)

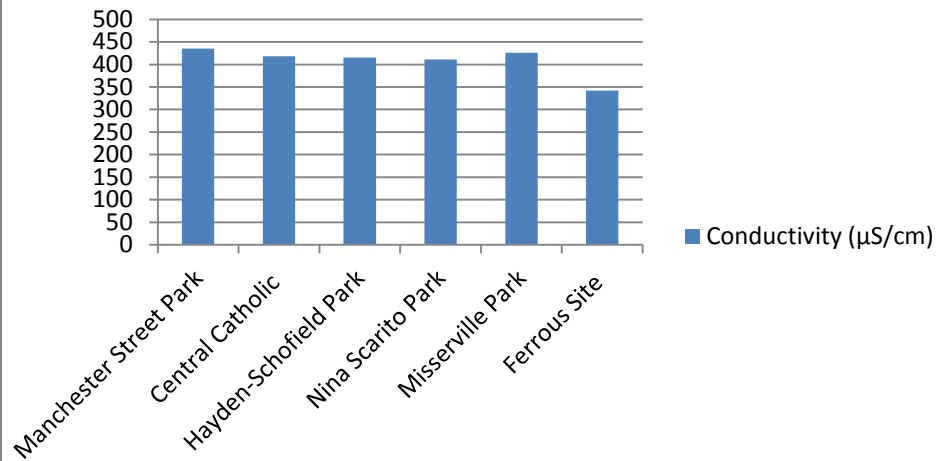

pH

