





October, 2013

Site	Parameters				
	Temperature (C)	Dissolved Oxygen (mg/L)	Conductivity (μ S/cm)	pH	Total Dissolved Solids (G/L)
Manchester Street Park	13.5	6.76	329	7.4	2.58
Central Catholic	13.79	9.44	344	7.53	0.27
Hayden-Schofield Park	13.9	8.72	345	7.60	0.272
Nina Scarito Park	15.78	6.3	939	7.57	0.772
Misserville Park	14.16	9.79	366	7.8	0.29
Ferrous Site	15.29	9.96	198	7.93	0.162
Duplicate					


Nutrient (Nitrates, Total Phosphorus, and Orthophosphates) & Turbidity Data

Site	Parameters				
	Nitrates	Total Phosphorus	Orthophosphates	Turbidity (NTU)	E. Coli (CFU)
Manchester Street Park	0.11	0	0	3.27	31.1
Central Catholic		0	0	2.19	124.3
Hayden-Schofield Park		0	0	1.69	77.6
Nina Scarito Park	1.22	0.05	0	1.59	1011.2
Misserville Park	0.36	0	0	1.56	228.2
Ferrous Site	0.84	0	0	1.26	158.5
Duplicate					159.4

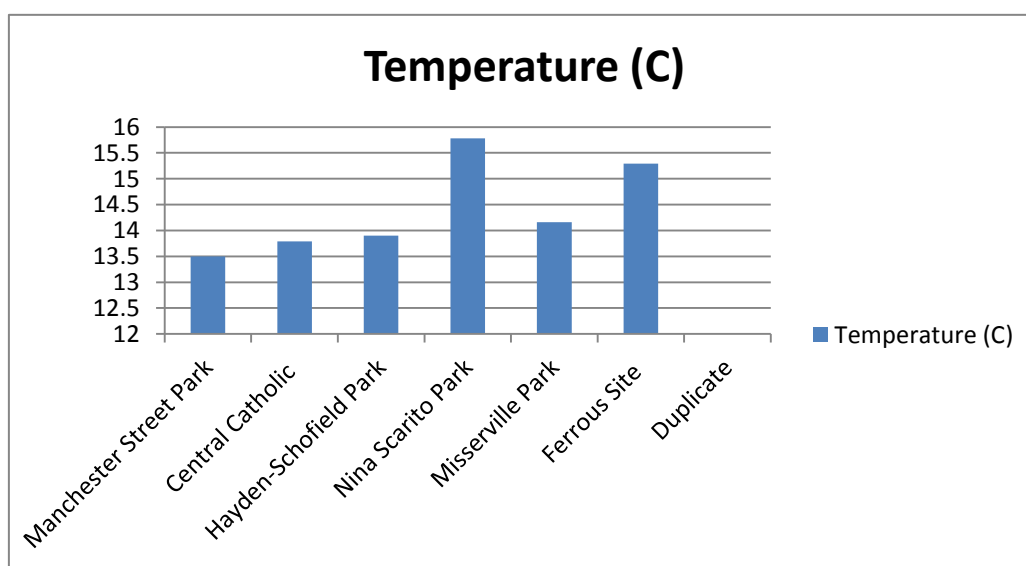


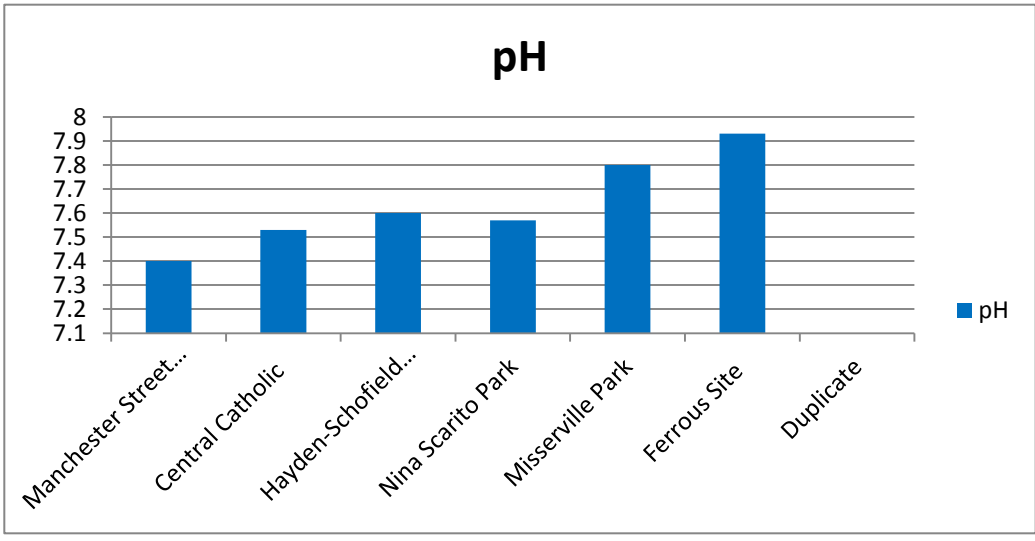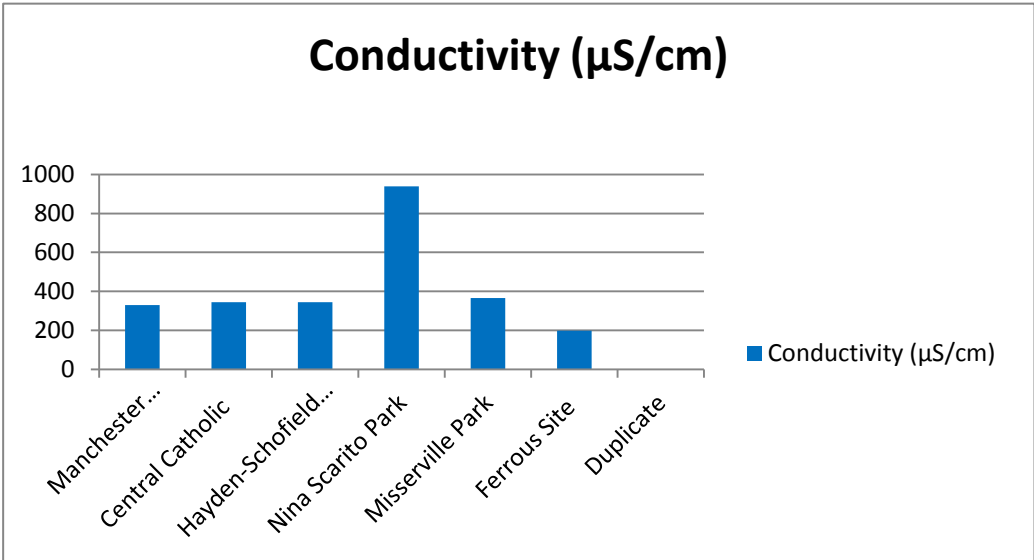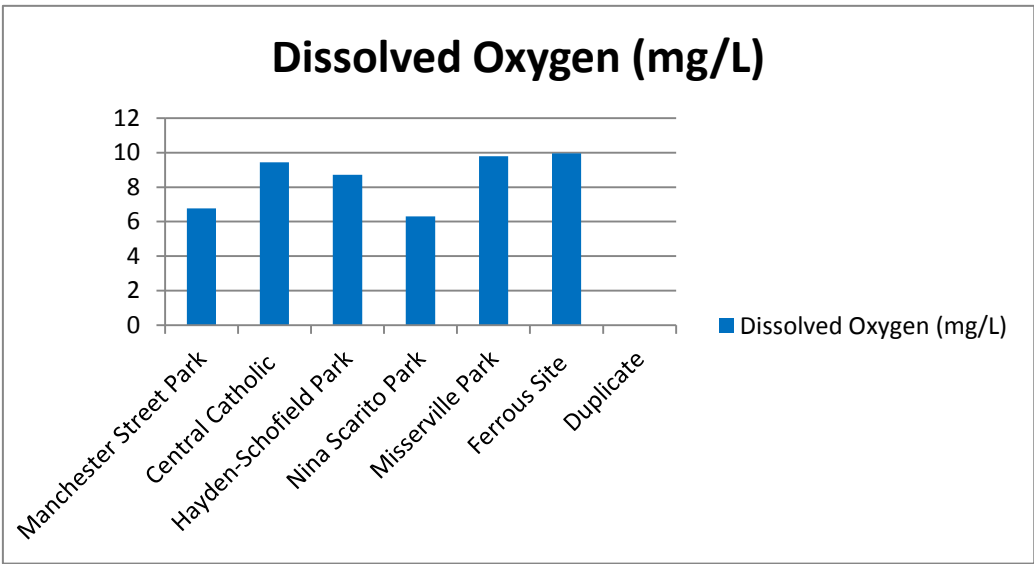

Total Dissolved Solids (G/L)

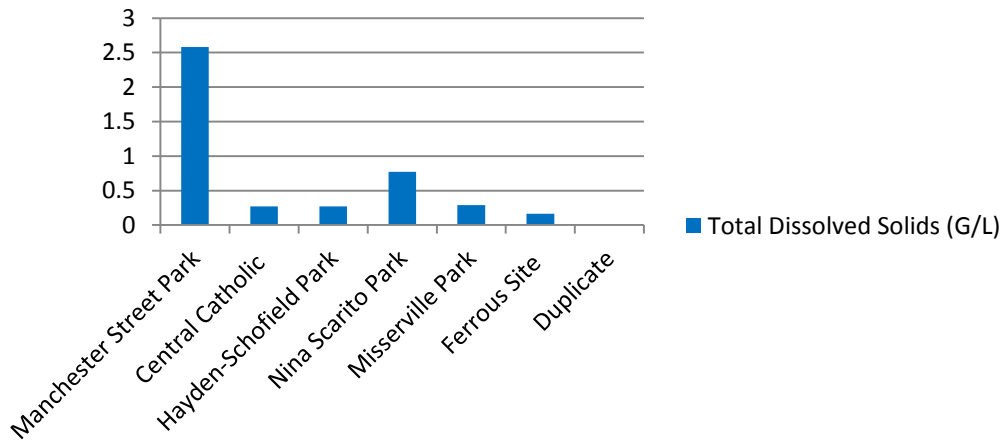

Nitrates

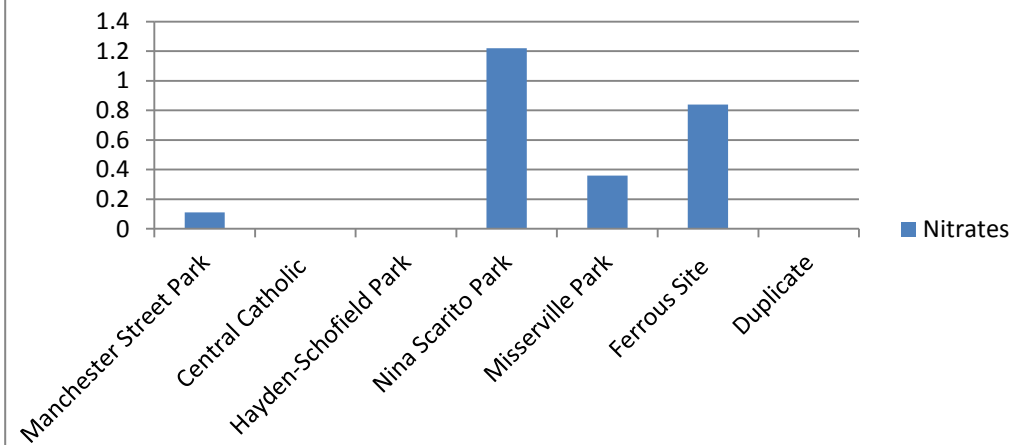

Total Phosphorus

